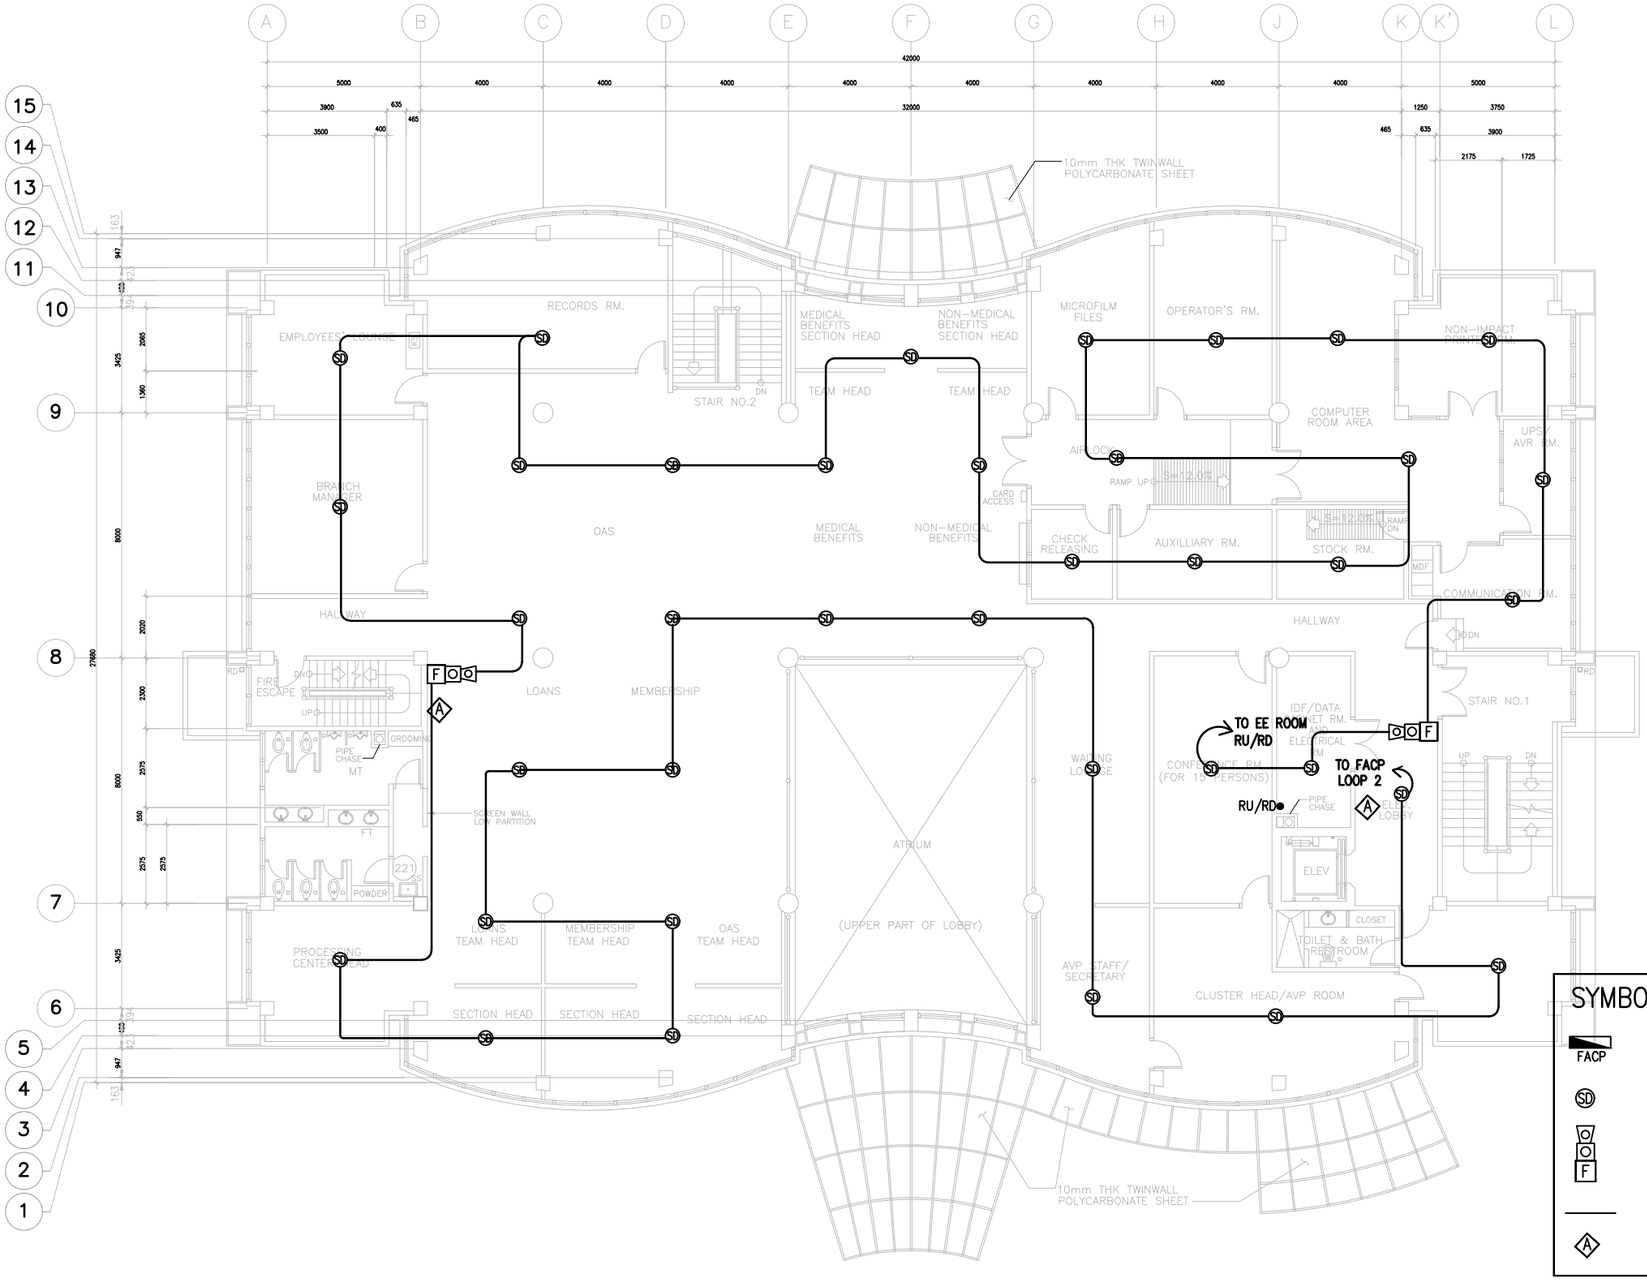

SYMBOLS & LEGEND

FACP	ADDRESSABLE FIRE ALARM CONTROL PANEL WITH COMPLETE ACCESSORIES AND ESSENTIAL WIRING SYSTEM (1.4M ABOVE FLOOR LEVEL)
SD	ADDRESSABLE PHOTOELECTRIC SMOKE DETECTOR WITH BASE
F	ADDRESSABLE HORN/SPEAKER WITH STROBELIGHT
F	ADDRESSABLE MANUAL PULL STATION
	TWISTED PAIR WIRE IN 20mmø IMC CONDUIT
A	ANNUNCIATOR

NOTE: TO INCLUDE MONITOR AND CONTROL MODULES FOR SUPERVISORY, FLOW SWITCHES AND EXISTING ELEVATORS. ROUGHING INS, WIRINGS AND PROGRAMMING TO BE SHOULDERED BY THE WINNING BIDDER.

1 / E-02

PROPOSED
SECOND FLOOR FIRE DETECTION AND ALARM SYSTEM
SCALE 1:200

SOCIAL SECURITY SYSTEM ENGINEERING AND FACILITIES MANAGEMENT DEPARTMENT	PROJECT TITLE: FIRE DETECTION AND ALARM SYSTEM AT CEBU BUILDING LOCATION: SSS Cebu Building - SSS Bldg. Osmeña Blvd., Brgy. Kalubihan, Cebu City	RECOMMENDING APPROVAL: CLARK Q. ESPERO ACTING HEAD, ENGINEERING & FACILITIES MANAGEMENT DEPARTMENT	APPROVED BY: TEDDY N. CARREON ACTING HEAD, GENERAL SERVICES DIVISION	APPROVED FOR IMPLEMENTATION: WENDELINO V. COMBOY, JR. ACTING HEAD, ADMINISTRATION GROUP	ENGINEERING SECTION DESIGNED & DRAWN BY: MMK S. Rogel, Sr. Engineer, EMT CHECKED BY: Elmer D. Mescallado, Sr. Engineer, EMT REVIEWED BY: Stephen M. Gatchalian, Acting SSO V, EMT	SHEET CONTENT: PROPOSED SECOND FLOOR FDAS LAYOUT	ALL DRAWINGS MUST BE VERIFIED ON SITE BY THE CONTRACTOR. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY TO THE ARCHITECT AND PROJECT MANAGERS. CONTRACTORS ARE TO PREPARE AND SUBMIT SHOP DRAWINGS TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORKS.	SHEET NO. E-02 DATE: January 19, 2026