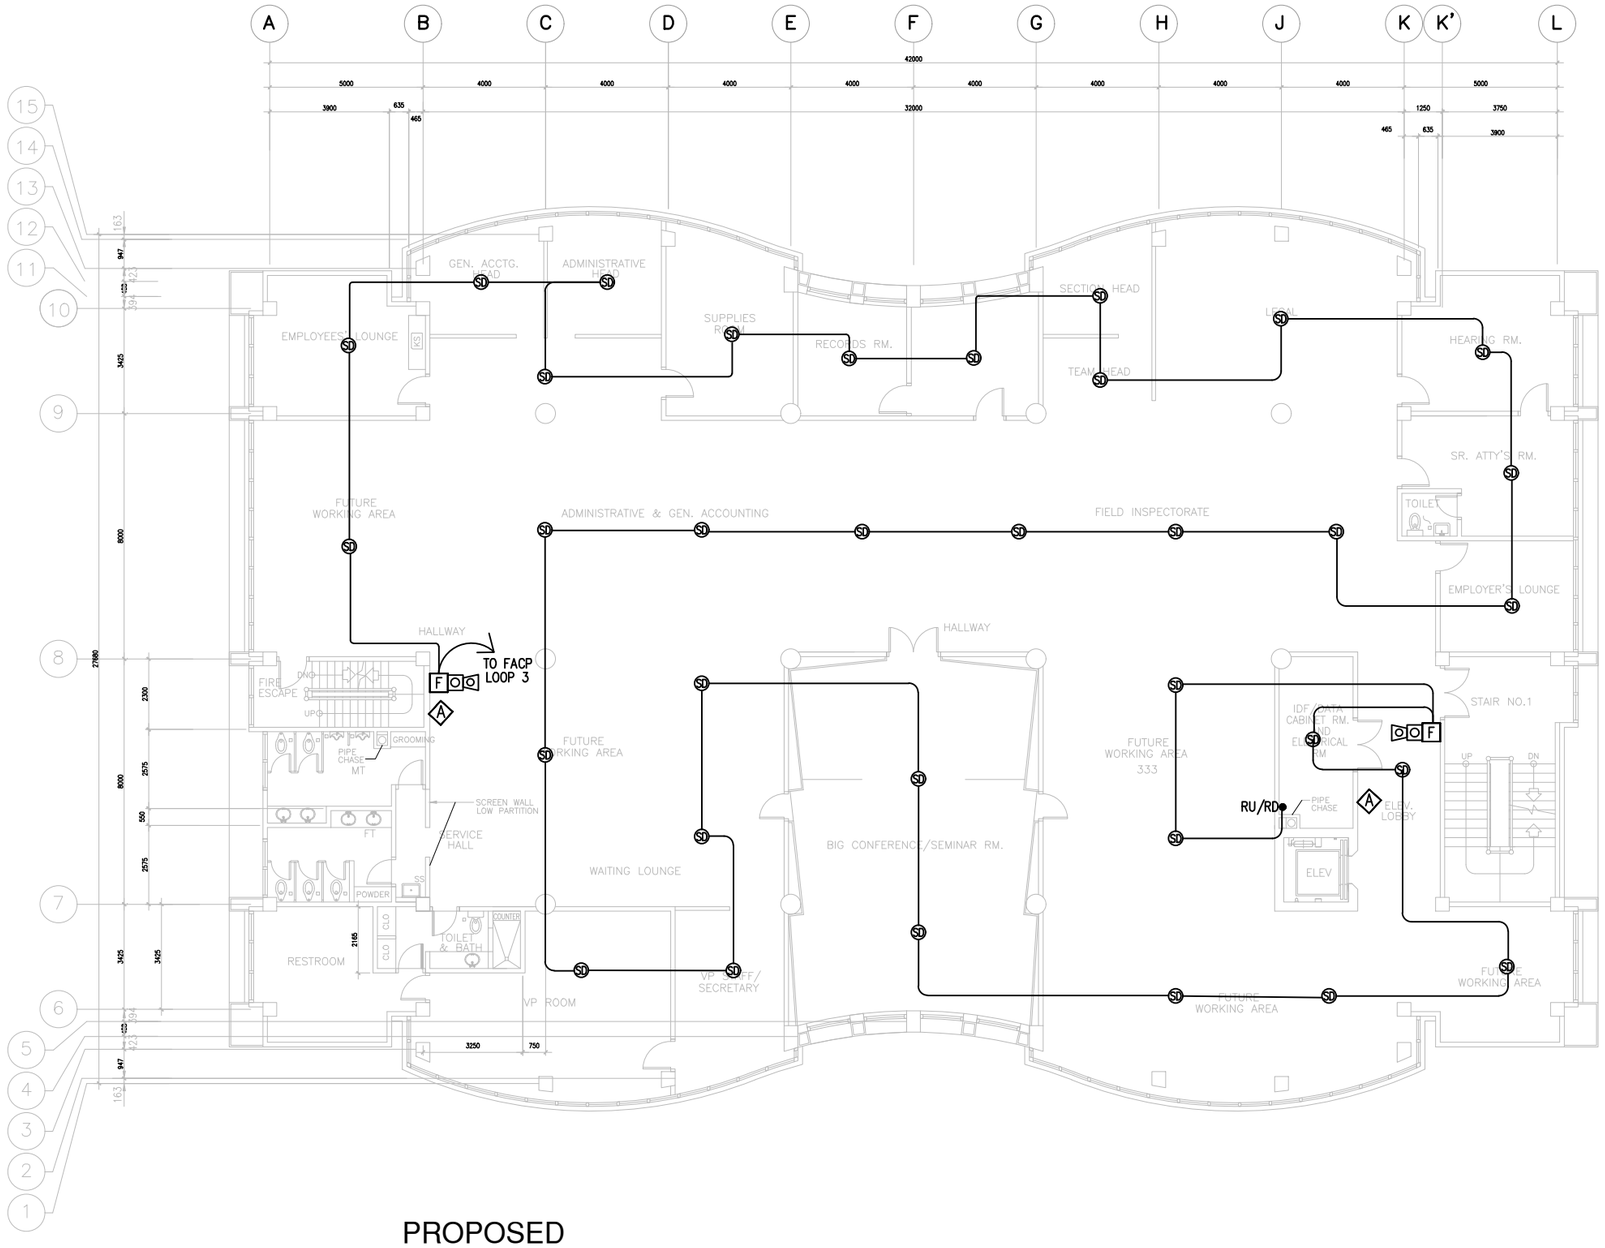

PROPOSED

THIRD FLOOR FIRE DETECTION AND ALARM SYSTEM

1 / E-03 SCALE 1:200

SYMBOLS & LEGEND

FACP	ADDRESSABLE FIRE ALARM CONTROL PANEL WITH COMPLETE ACCESSORIES AND ESSENTIAL WIRING SYSTEM (1.4M ABOVE FLOOR LEVEL)
SD	ADDRESSABLE PHOTOELECTRIC SMOKE DETECTOR WITH BASE
O O F	ADDRESSABLE HORN/SPEAKER WITH STROBELIGHT
F	ADDRESSABLE MANUAL PULL STATION
———	TWISTED PAIR WIRE IN 20mmø IMC CONDUIT
A	ANNUNCIATOR

NOTE: TO INCLUDE MONITOR AND CONTROL MODULES FOR SUPERVISORY, FLOW SWITCHES AND EXISTING ELEVATORS. ROUGHING INS, WIRINGS AND PROGRAMMING TO BE SHOULDERED BY THE WINNING BIDDER.

SOCIAL SECURITY SYSTEM
ENGINEERING AND FACILITIES MANAGEMENT DEPARTMENT

PROJECT TITLE:
FIRE DETECTION AND ALARM SYSTEM AT CEBU BUILDING

LOCATION: SSS Cebu Building - SSS Bldg. Osmeña Blvd., Brgy. Kalubihan, Cebu City

RECOMMENDING APPROVAL:
CLARK Q. ESPERO
ACTING HEAD,
ENGINEERING & FACILITIES MANAGEMENT DEPARTMENT

APPROVED BY:
TEDDY N. CARREON
ACTING HEAD,
GENERAL SERVICES DIVISION

APPROVED FOR IMPLEMENTATION:
WENDELINO V. COMBOY, JR.
ACTING HEAD,
ADMINISTRATION GROUP

ENGINEERING SECTION
DESIGNED & DRAWN BY: MMK S. Rogel, Sr. Engineer, EMT
CHECKED BY: Elmer D. Mescallado, Sr. Engineer, EMT
REVIEWED BY: Stephen M. Gatchalian, Acting SSO V, EMT

SHEET CONTENT:
PROPOSED THIRD FLOOR FDAS LAYOUT

ALL DRAWINGS MUST BE VERIFIED ON SITE BY THE CONTRACTOR. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY TO THE ARCHITECT AND PROJECT MANAGERS.

CONTRACTORS ARE TO PREPARE AND SUBMIT SHOP DRAWINGS TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORKS.

SHEET NO.
E-03

DATE:
Jan. 19, 2026