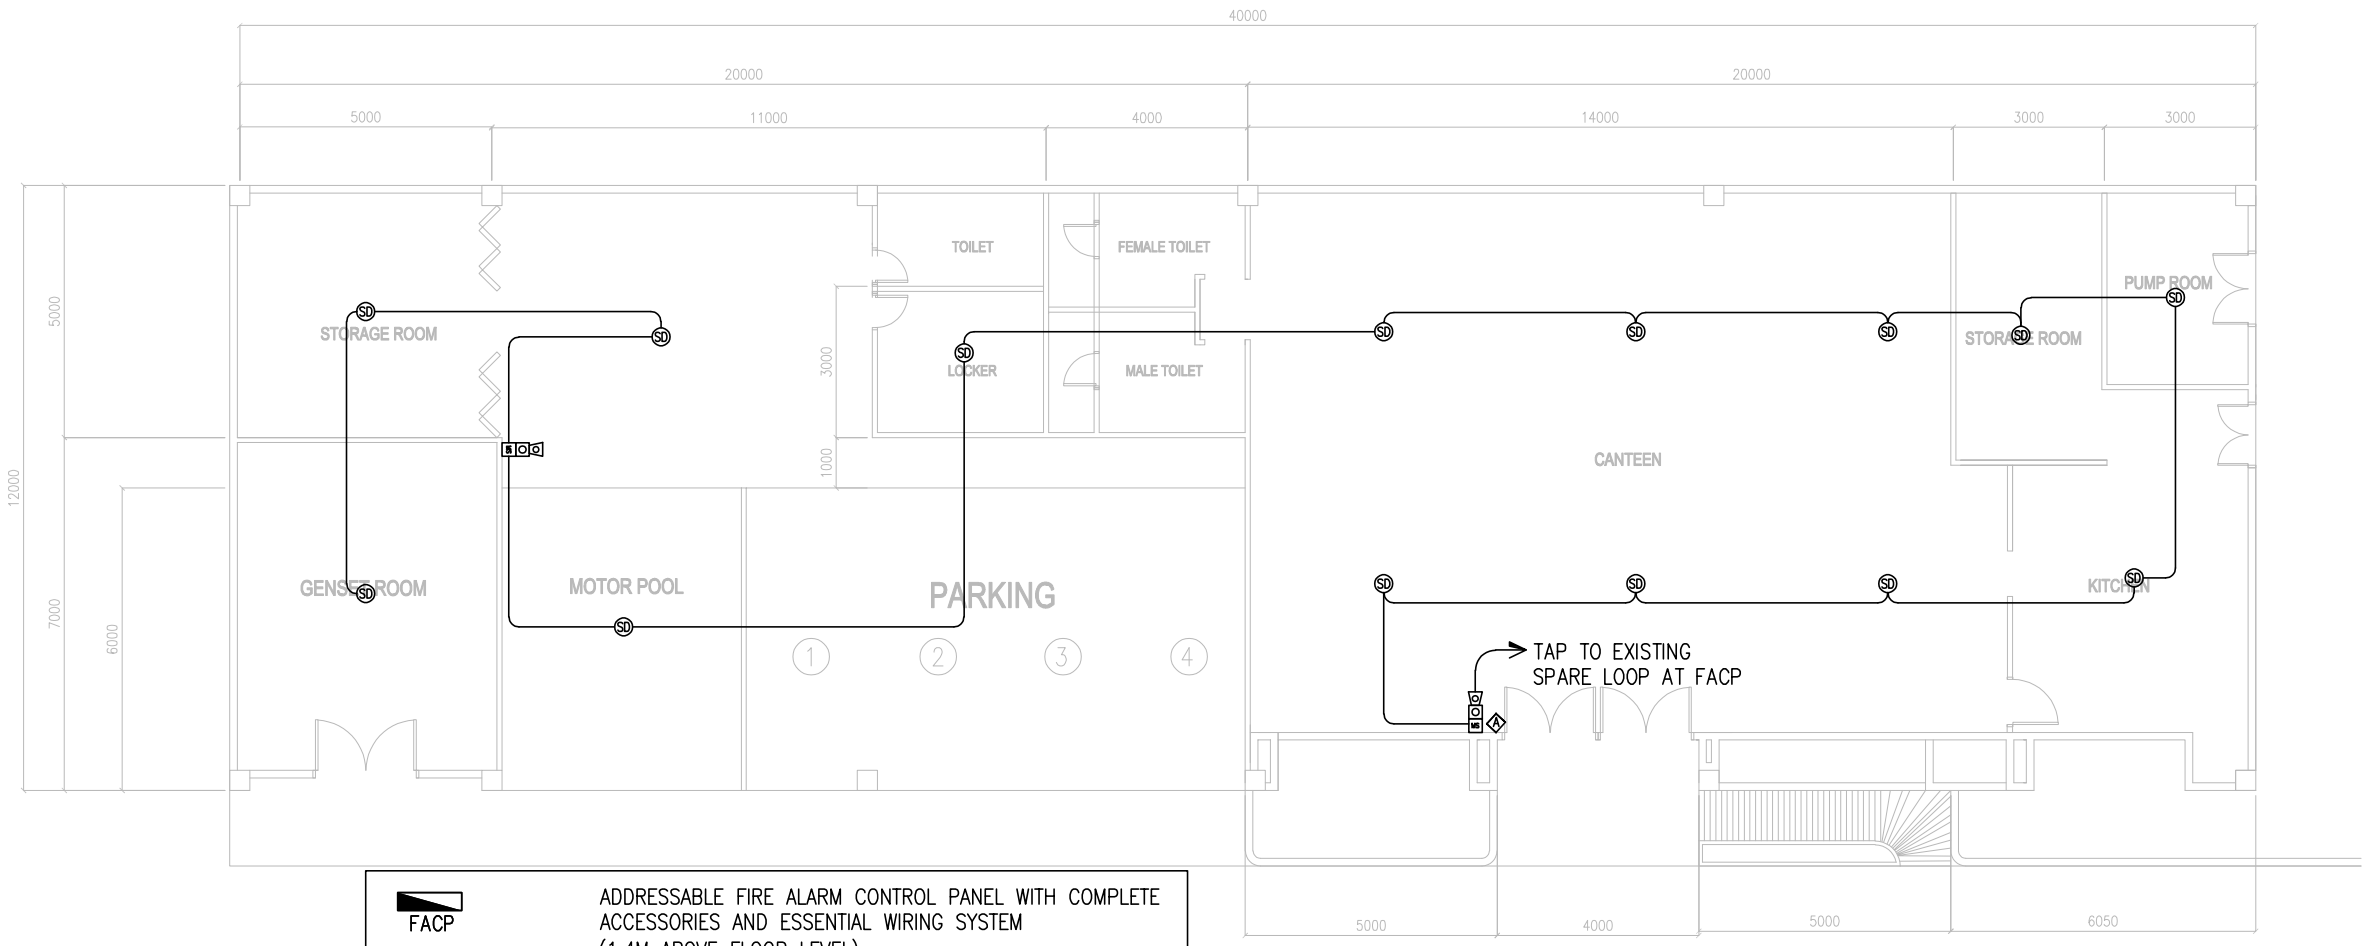

FACP	ADDRESSABLE FIRE ALARM CONTROL PANEL WITH COMPLETE ACCESSORIES AND ESSENTIAL WIRING SYSTEM (1.4M ABOVE FLOOR LEVEL)
SD	ADDRESSABLE SMOKE DETECTOR WITH BASE
MS	ADDRESSABLE HORN WITH STROBELIGHT
MS	ADDRESSABLE MANUAL PULL STATION WITH BREAK GLASS
———	TWISTED PAIR WIRE IN 20mmø PVC CONDUIT
A	ANNUNCIATOR

1 FDAS LAYOUT

F-02 SCALE 1:150

SOCIAL SECURITY SYSTEM

ENGINEERING AND FACILITIES MANAGEMENT DEPARTMENT

PROJECT TITLE:

REPLACEMENT OF FIRE DETECTION
AND ALARM SYSTEM
AT SSS DAVAO BUILDING

LOCATION: **SSS Bldg., J.P. Laurel Ave., Brgy. 20B (Pob.), Davao City, Davao Del Sur**

RECOMMENDING APPROVAL:

CLARK Q. ESPERO
ACTING HEAD, ENGINEERING & FACILITIES MANAGEMENT DEPARTMENT

APPROVED BY:

TEDDY N. CARREON
ACTING VICE PRESIDENT GENERAL SEVICES DEPARTMENT

APPROVED FOR IMPLEMENTATION:

WENDELINO V. COMBOY JR.
ACTING HEAD, ADMINISTRATION GROUP

ENGINEERING SECTION

DESIGNED & DRAWN BY:
Matt Fredrick S. Ibasan - JO Engineer, EMT

CHECKED BY:
Elmer D. Mescallado - Senior Engineer, EMT

REVIEWED BY:
Stephen M. Gatchalian - Acting SSO V, EMT

SHEET CONTENT:
FDAS LAYOUT

ALL DRAWINGS MUST BE VERIFIED ON SITE BY THE CONTRACTOR. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY TO THE ARCHITECT AND PROJECT MANAGERS.

CONTRACTORS ARE TO PREPARE AND SUBMIT SHOP DRAWINGS TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORKS.

SHEET NO.
F-01

DATE:
JAN. 27, 2025