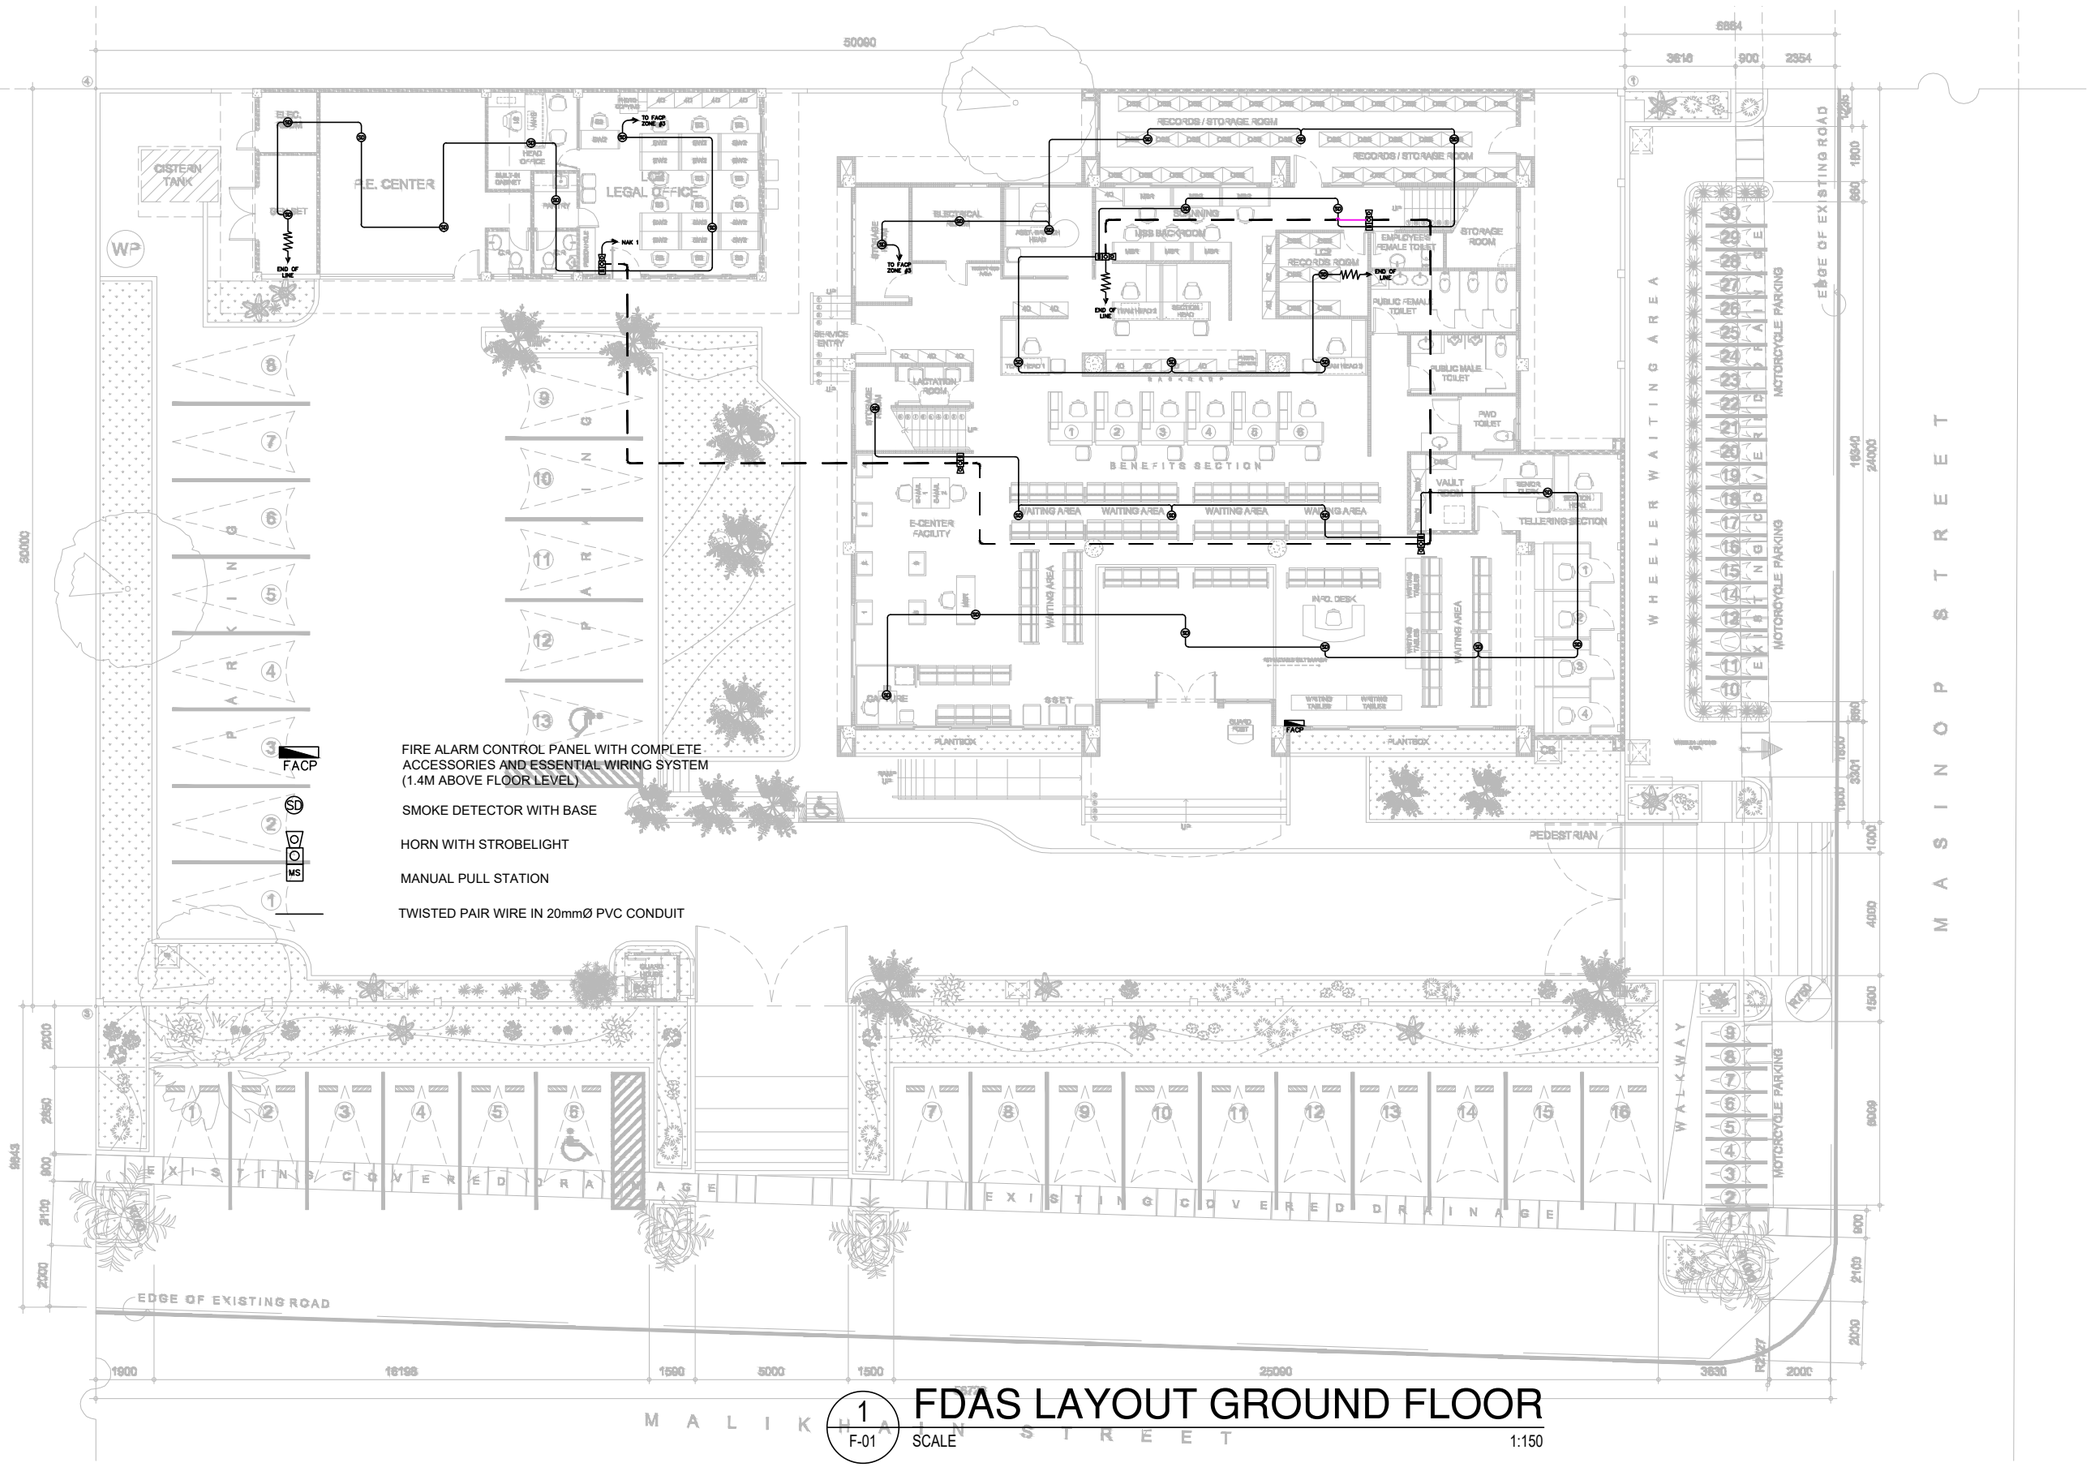

1 FDAS LAYOUT GROUND FLOOR

F-01 SCALE 1:150

SOCIAL SECURITY SYSTEM ENGINEERING AND FACILITIES MANAGEMENT DEPARTMENT	PROJECT TITLE: REPLACEMENT OF FIRE DETECTION AND ALARM SYSTEM AT SSS PAMPANGA BUILDING LOCATION: SSS Bldg., Diosdado Macapagal Government Center Brgy. Maimpis, City of San Fernando, Pampanga	RECOMMENDING APPROVAL: CLARK Q. ESPERO ACTING HEAD, ENGINEERING & FACILITIES MANAGEMENT DEPARTMENT	APPROVED BY: TEDDY N. CARREON ACTING VICE PRESIDENT GENERAL SEVICES DEPARTMENT	APPROVED FOR IMPLEMENTATION: WENDELINO V. COMBOY JR. ACTING HEAD, ADMINISTRATION GROUP	ENGINEERING SECTION DESIGNED & DRAWN BY: Matt Fredrick S. Ibasan - JO Engineer, EMT CHECKED BY: Elmer D. Mescallado - Senior Engineer, EMT REVIEWED BY: Stephen M. Gatchalian - Acting SSO V, EMT	SHEET CONTENT: FDAS LAYOUT GROUND FLOOR ALL DRAWINGS MUST BE VERIFIED ON SITE BY THE CONTRACTOR. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY TO THE ARCHITECT AND PROJECT MANAGERS. CONTRACTORS ARE TO PREPARE AND SUBMIT SHOP DRAWINGS TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORKS.	SHEET NO. F-01 DATE: JAN. 19, 2025

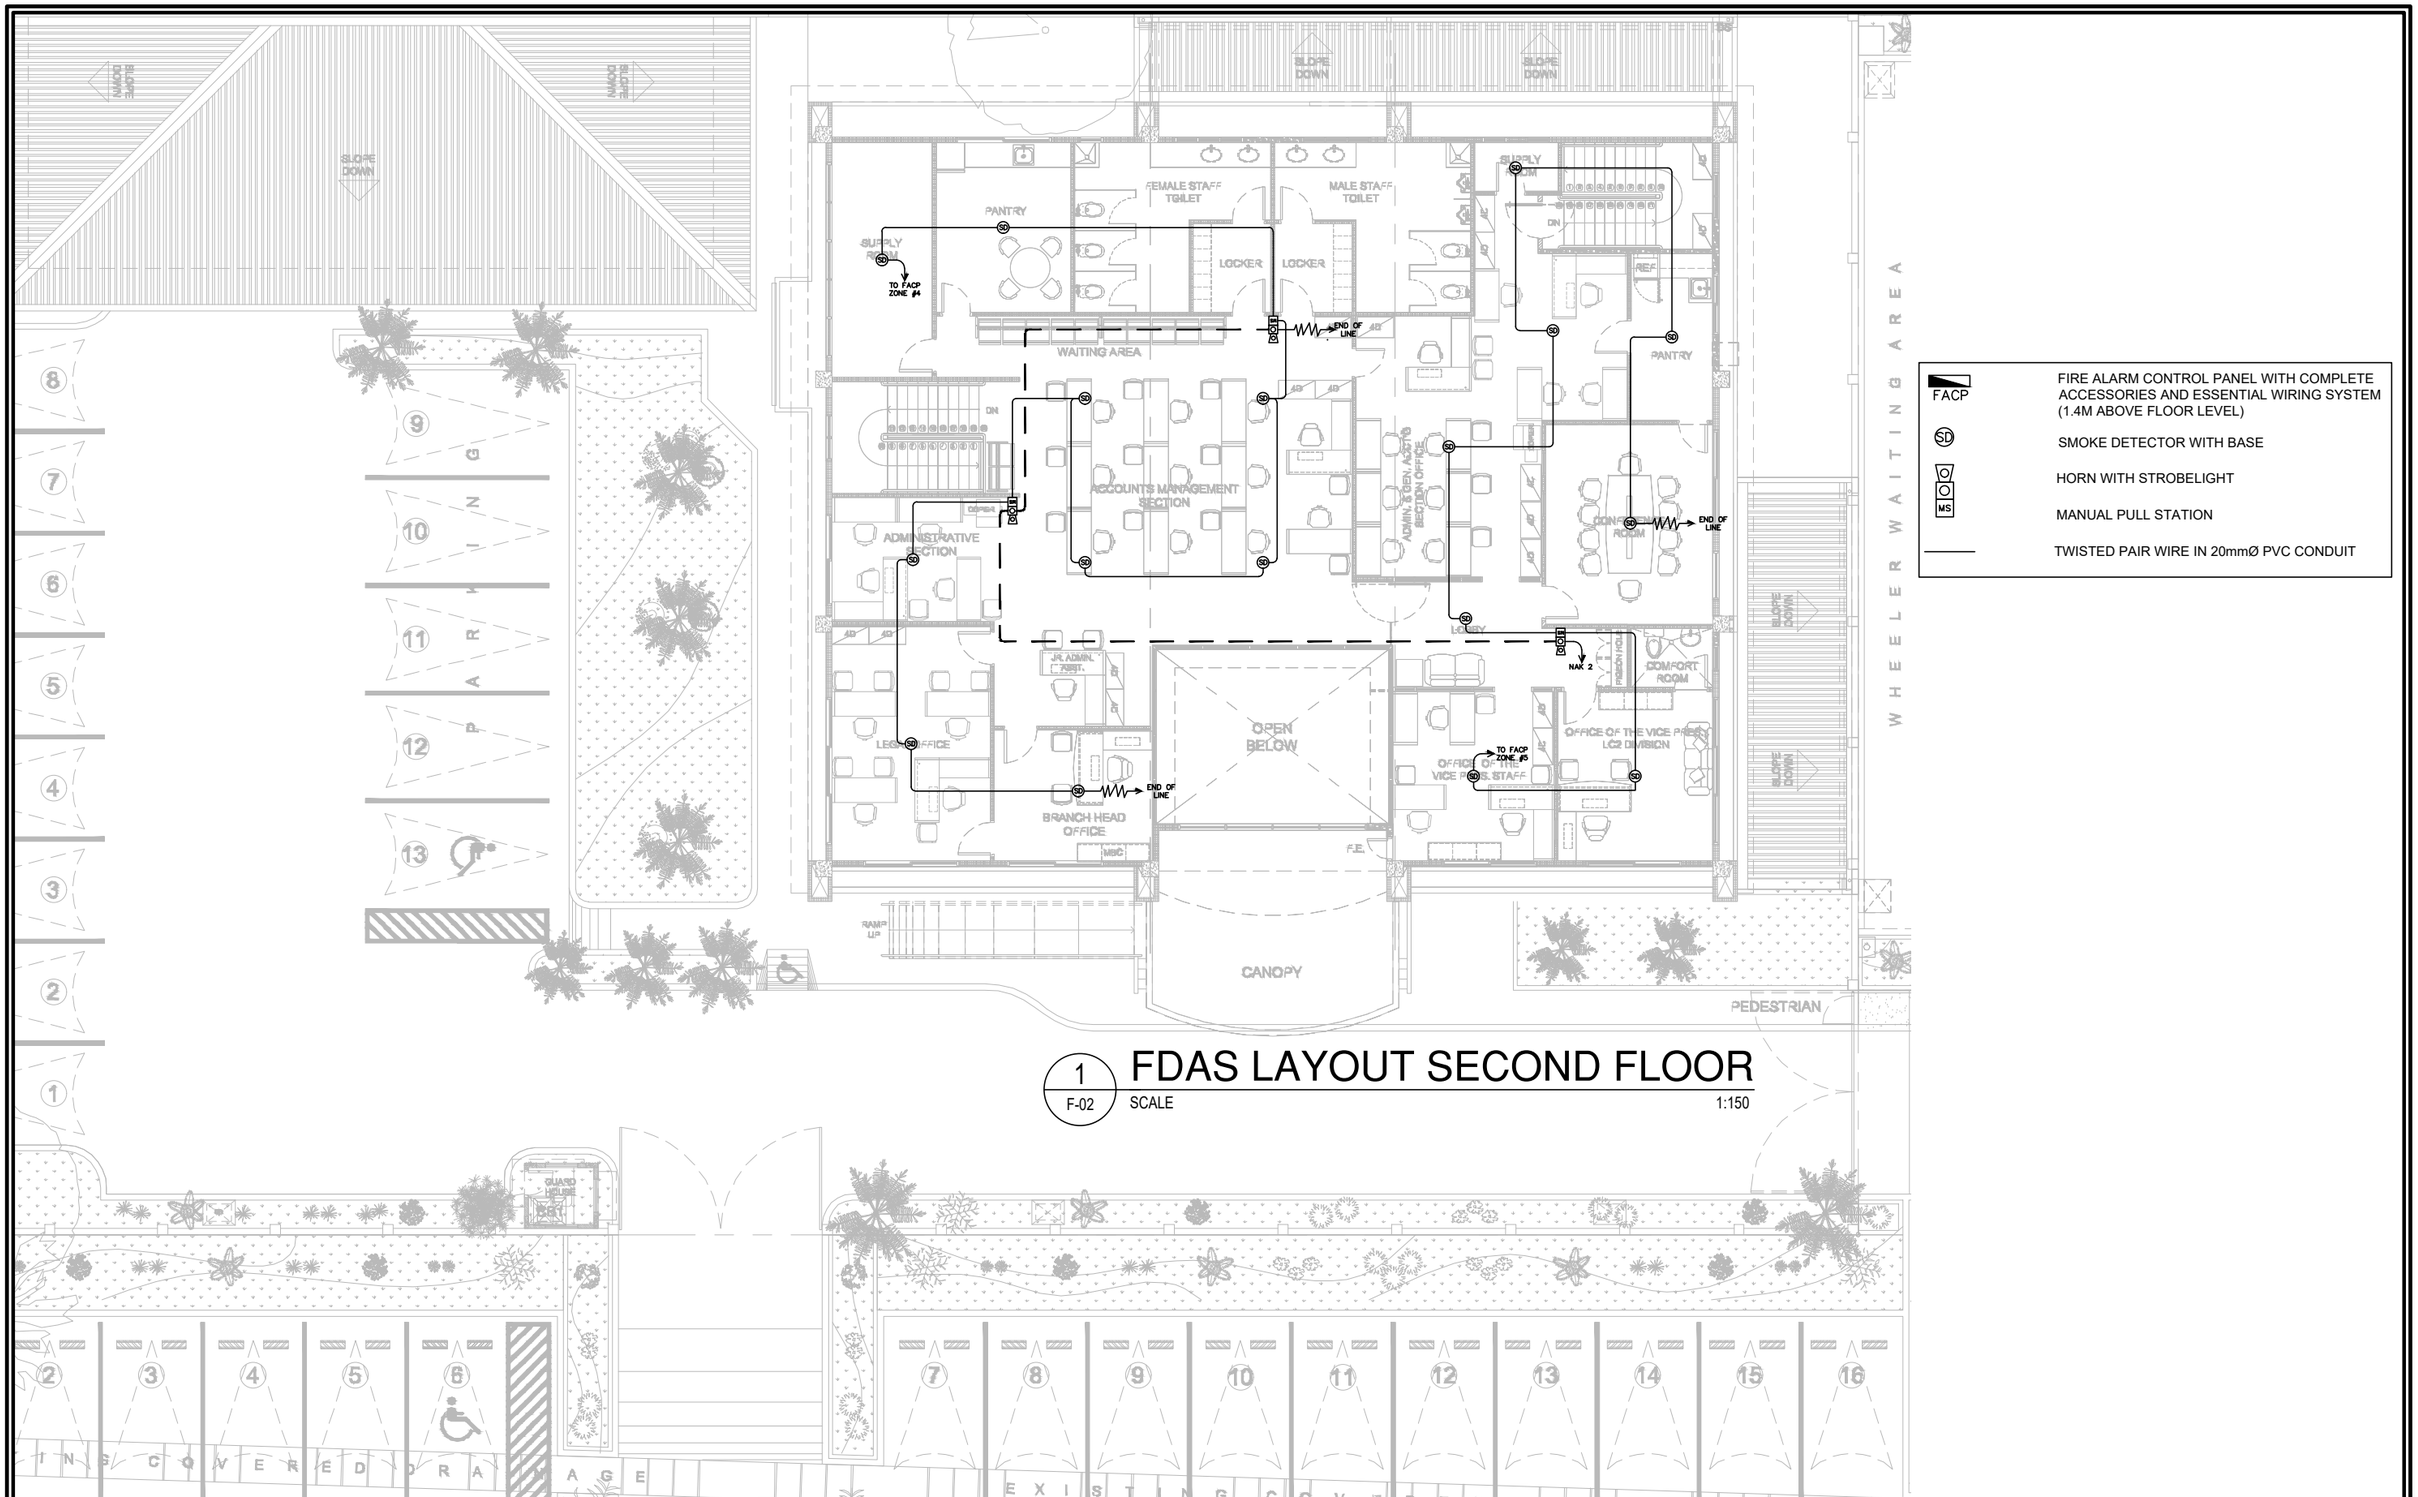

FACP — FIRE ALARM CONTROL PANEL WITH COMPLETE ACCESSORIES AND ESSENTIAL WIRING SYSTEM (1.4M ABOVE FLOOR LEVEL)

SD — SMOKE DETECTOR WITH BASE

HORN WITH STROBELIGHT

MS — MANUAL PULL STATION

TWISTED PAIR WIRE IN 20mmØ PVC CONDUIT

1 FDAS LAYOUT SECOND FLOOR

F-02 SCALE 1:150

SOCIAL SECURITY SYSTEM
ENGINEERING AND FACILITIES MANAGEMENT DEPARTMENT

PROJECT TITLE:
REPLACEMENT OF FIRE DETECTION AND ALARM SYSTEM AT SSS PAMPANGA BUILDING
LOCATION: SSS Bldg., Diosdado Macapagal Government Center Brgy. Maimpis, City of San Fernando, Pampanga

RECOMMENDING APPROVAL:
CLARK Q. ESPERO
ACTING HEAD, ENGINEERING & FACILITIES MANAGEMENT DEPARTMENT

APPROVED BY:
TEDDY N. CARREON
ACTING VICE PRESIDENT GENERAL SEVICES DEPARTMENT

APPROVED FOR IMPLEMENTATION:
WENDELINO V. COMBOY JR.
ACTING HEAD, ADMINISTRATION GROUP

ENGINEERING SECTION
DESIGNED & DRAWN BY: Matt Fredrick S. Ibasan - JO Engineer, EMT
CHECKED BY: Elmer D. Mescallado - Senior Engineer, EMT
REVIEWED BY: Stephen M. Gatchalian - Acting SSO V, EMT

SHEET CONTENT: FDAS LAYOUT SECOND FLOOR

ALL DRAWINGS MUST BE VERIFIED ON SITE BY THE CONTRACTOR. ALL DISCREPANCIES SHOULD BE REPORTED IMMEDIATELY TO THE ARCHITECT AND PROJECT MANAGERS.

CONTRACTORS ARE TO PREPARE AND SUBMIT SHOP DRAWINGS TO THE ARCHITECT PRIOR TO COMMENCEMENT OF WORKS.

SHEET NO. F-02

DATE: JAN. 19, 2025